


## Product Code

# 3144W/25

Check Valve

3.1/8" ODS<br>PS = 45 bar - (2) PSI

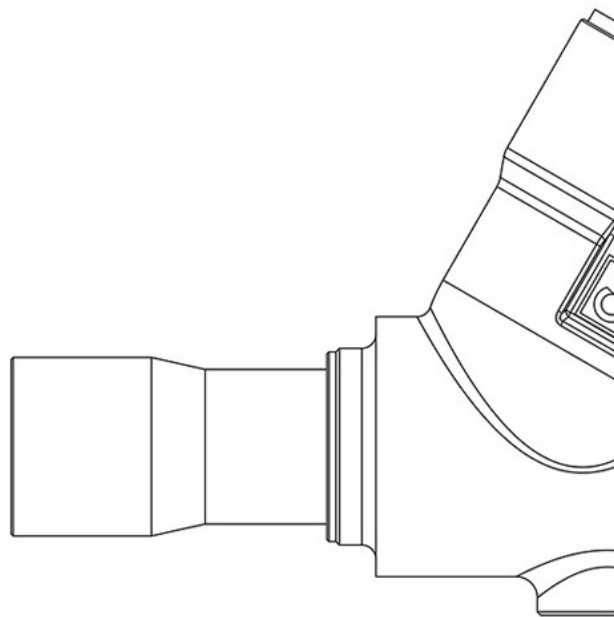

## Product use

Accessories for use with the following ASHRAE 34:2019 refrigerants, Class A1:

HCFC (R22)

HFC (R134a, R404A, R407C, R410A, R507)

HFO (R1234ze)

HFO + HFC (R448A, R449A, R450A, R452A, R513A, R515A, R515B)

## Product Details

**Connections SAE Flare** -

**Connections ODS Ø [in.]** 3.1/8"

**ODS Ø [mm]** -

**Kv [m<sup>3</sup>/h]** 39

**Differential pressure (2) [bar]** 0,04

**PS [bar]** 45

**MWP [psi] (1)** 650

**TS [°C] Min** -40

**TS [°C] Max** +150

**Package pcs** 1

## Notes where expressly stated

(1): according to UL approval

(2): minimum pressure at which the valve is completely open.